


MODEL NUMBER	NOMINAL SIZE (INCHES) H x W x D	ACTUAL SIZE (INCHES) H x W x D	RATED AIR FLOW (CFM)	INITIAL RESISTANCE (In. W.G.)		MEDIA AREA (SQ. FT)
				90-95%	60-65%	
SLVA**GT-4412	24 x 24 x 12	23-3/8 X 23-3/8 X 11-1/2	2500	0.65	0.48	194
SLVA**GT-2412	12 x 24 x 12	11-3/8 X 23-3/8 X 11-1/2	1250	0.65	0.48	97

** - Filter Efficiency (95 = 90-95%, 65 = 60-65%)

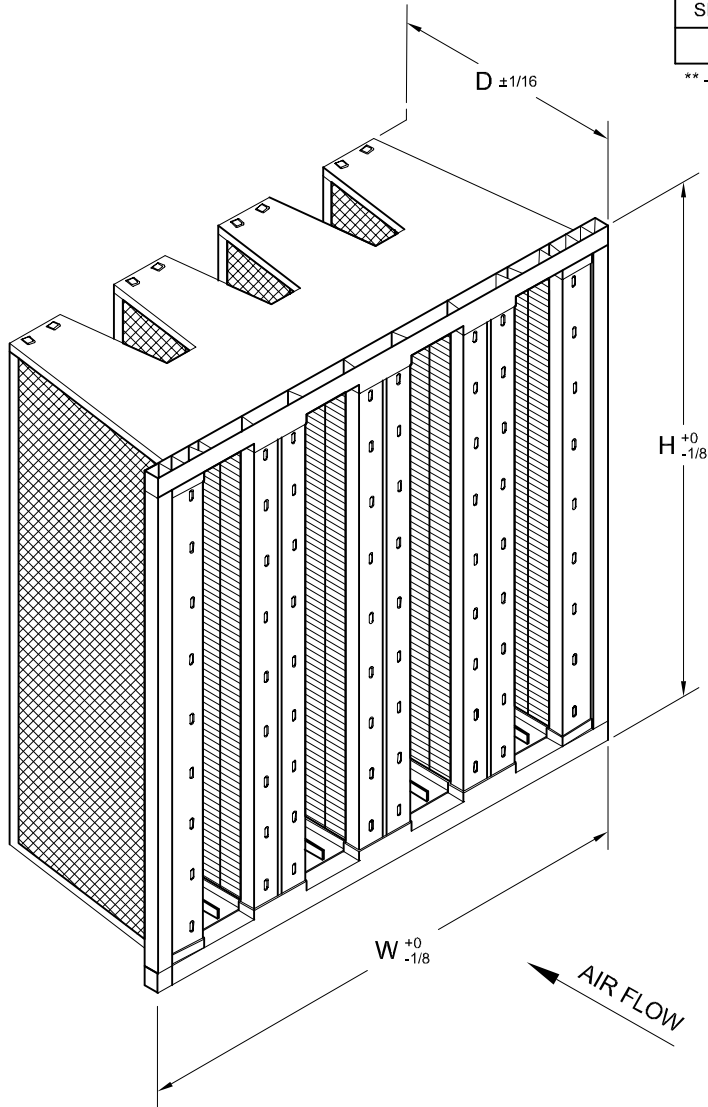

STANDARD CONSTRUCTION

1. High Efficiency, Microglass Paper Media
2. Mini-Pleat Bead Separator Packs
3. Rigid Plastic End Plates
4. Galvanized Steel Support Struts
5. Urethane Sealant In Vertical Struts
6. Expanded Metal Faceguards On Air Leaving Side

NOTES

1. Average Efficiency, MERV (52.2)
90-95% ASHRAE 52.1 - 1992, MERV 14 ASHRAE 52.2 - 1999
60-65% ASHRAE 52.1 - 1992, MERV 13 ASHRAE 52.2 - 1999
2. Recommended Final Resistance: 2.5" W.G.
3. Burst Strength: 25" W.G.
4. Rated Velocity 12" Deep - 625 FPM
5. Class 2 Filter Per U.L. Standard 900
6. Maximum Operating Temperature: 180 deg. F
7. Optional Gasket Available
D - Air Leaving Side (Ex. SLVA95GT-4412-D)



P.O. Box 32578
Louisville, KY 40232
P: 866-925-2247
F: 502-961-0930
www.purolatorair.com

CONTACT FACTORY TO
VERIFY REVISION LEVEL

**TOLERANCES
UNLESS OTHERWISE SPECIFIED**

FRACTIONAL -
DECIMAL -
ANGLES -

ALL DIMENSIONS IN INCHES

DRAWING NAME

SERVA-CELL VA - GT

APPROVED BY

K. Quinn

SPECIFICATION NO.

MKT-P-00181

PAGE

1 OF 1

SCALE

NONE

DWG. SIZE

A

REVISION

A

REVISION DATE

5-23-08

CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY CLC AIR. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.