


Model Number	Nominal Size (inches) W x H x D	Actual Size (inches) W x H x D	Rated Air Flow (CFM)	Initial Resistance (IN W.G.)	Media Area (Square Feet)
KPH-STD4-2404	12 x 24 x 4	11- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	1000	0.21	13.0
KPH-STD4-6004	16 x 20 x 4	15- ¹ / ₂ x 19- ¹ / ₂ x 3- ³ / ₄	1120	0.21	14.9
KPH-STD4-6504	16 x 25 x 4	15- ¹ / ₂ x 24- ¹ / ₂ x 3- ³ / ₄	1400	0.21	18.8
KPH-STD4-8404	18 x 24 x 4	17- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	1500	0.21	19.7
KPH-STD4-0004	20 x 20 x 4	19- ¹ / ₂ x 19- ¹ / ₂ x 3- ³ / ₄	1400	0.21	22.2
KPH-STD4-0404	20 x 24 x 4	19- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	1670	0.21	18.5
KPH-STD4-0504	20 x 25 x 4	19- ¹ / ₂ x 24- ¹ / ₂ x 3- ³ / ₄	1750	0.21	22.3
KPH-STD4-4404	24 x 24 x 4	23- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	2000	0.21	26.5

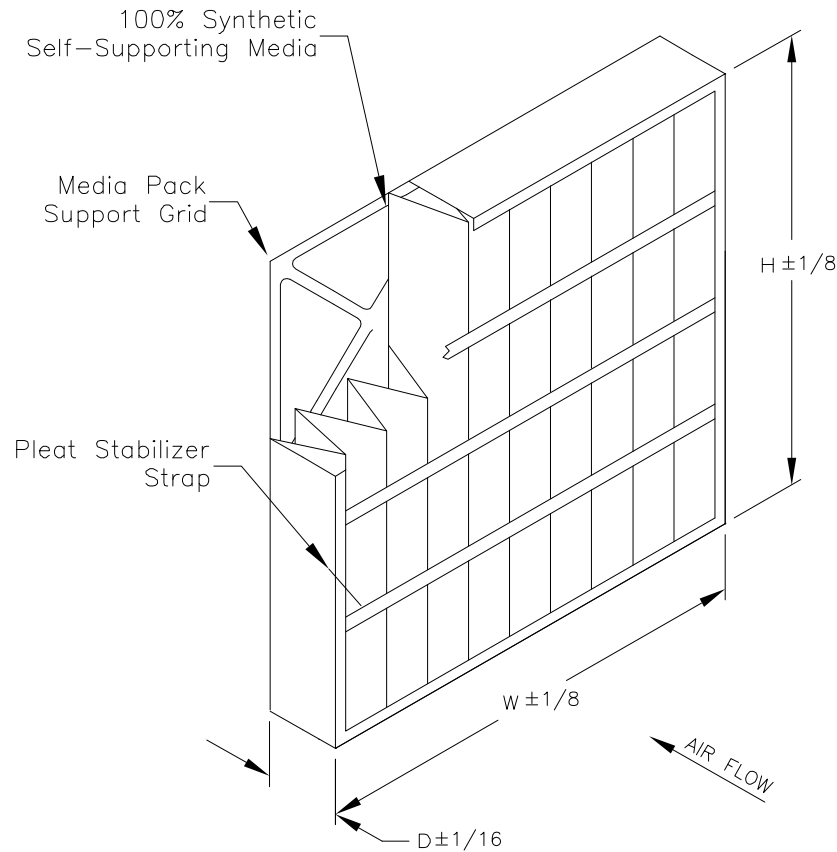

STANDARD CONSTRUCTION

- 100% Synthetic, Self-Supporting Media
- 11.3 Pleats Per Foot
- (3) Pleat Stabilizer Straps, Upstream Side
- Media Pack Support Grid, Downstream Side
- Moisture Resistant Beverage Board Frame

NOTES

- MERV 8 per ASHRAE 52.2-2007
Tested At 492 FPM on 24x24x4 Nominal Size
- MERV-A 8-A ASHRAE 52.2-2007 Appendix J
Final Resistance: 1.0" W.G.
- Rated Velocity: 500 FPM
- Class 2 Filter per U.L. Standard 900
- Maximum Operating Temperature: 150 deg. F

Purolator
 100 River Ridge Circle
 Jeffersonville, IN 47130
 P: 866-925-2247
 F: 502-961-0930
 www.purolatorair.com

CONTACT FACTORY TO
 VERIFY REVISION LEVEL

TOLERANCES UNLESS OTHERWISE SPECIFIED

FRACTIONAL -
 DECIMAL -
 ANGLES -

ALL DIMENSIONS IN INCHES

DRAWING NAME

KEY PLEAT HIGH-CAPACITY SSP 4" DEPTH

APPROVED BY

[Signature]

SPECIFICATION NO.

MKT-P-00597

PAGE

1 OF 1

SCALE

NONE

DWG. SIZE

A

REVISION

C

REVISION DATE

05-06-11

CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY CLC AIR. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.